

Pressed Steel Grilles and Fire Blocks



December 2025


Pressed Steel Grilles

Typical Dimensions:



December 2025

Typical Installation:

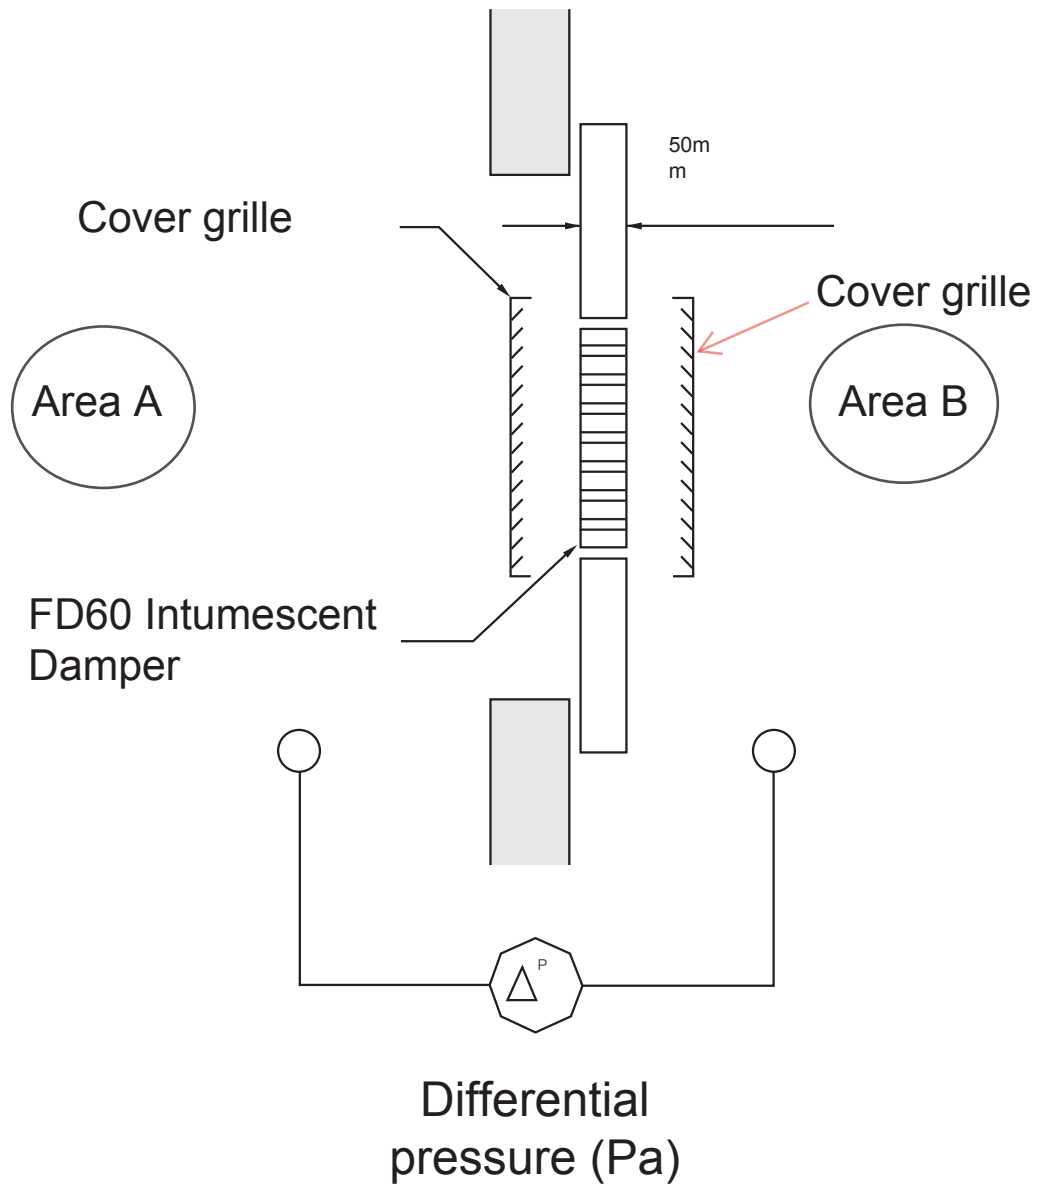


December 2025

FD60 Fire Rated Intumescent Block Performance Guide

Performance Criteria

Based on a pair of pressed Steel Grilles and a FD60 intumescent fire block type FD60

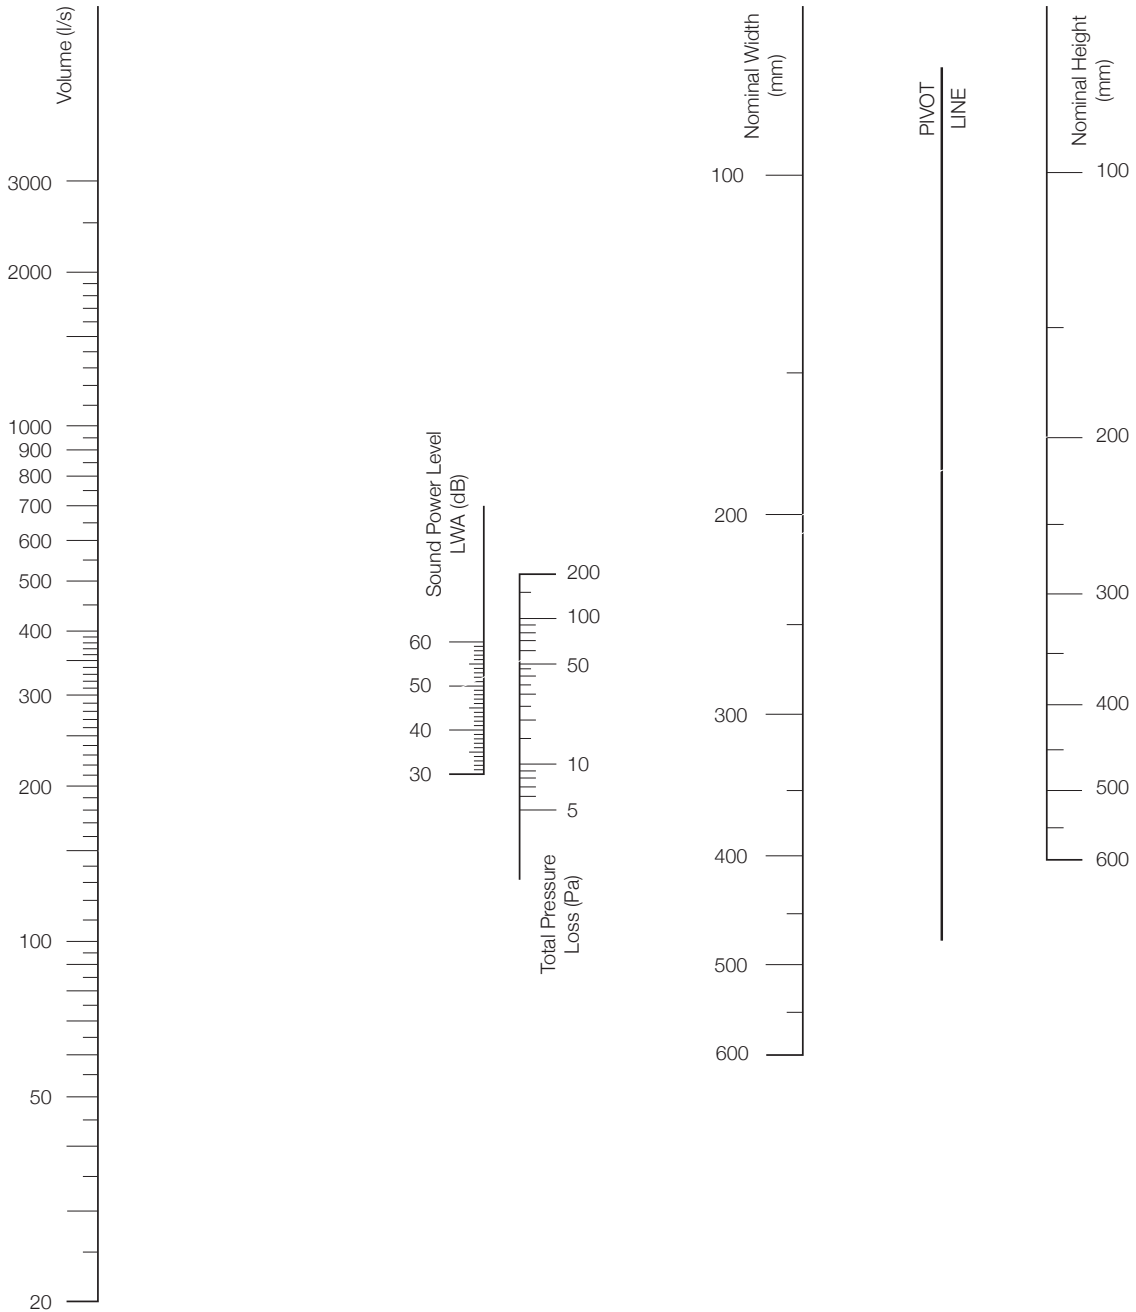

Example shown above:

Type: FD60 - 300 x 300

Flow rate: (l/s): 90

Total pressure drop: ΔP_t (Pa): 5

Radiated sound power LWA (dB): <30

December 2025